
### Catastrophic Events to the U.S. Electric Grid



#### Grid Assurance can <u>simultaneously deliver of 1 to 5 Extra High Voltage (EHV) transformers</u>

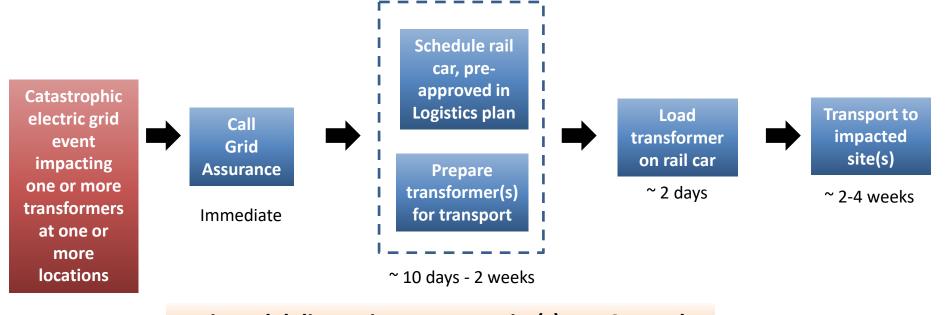


Projected delivery time to event site(s): 4 – 6+ weeks

3<sup>rd</sup> Party EHV transformer delivery time to one event site: 9 – 16 weeks **for one transformer** 

New EHV transformer delivery time to event site: 1 year+

# **GRID**ASSURANCE

## Catastrophic Electric Grid Event: 3rd Party Transformer Delivery

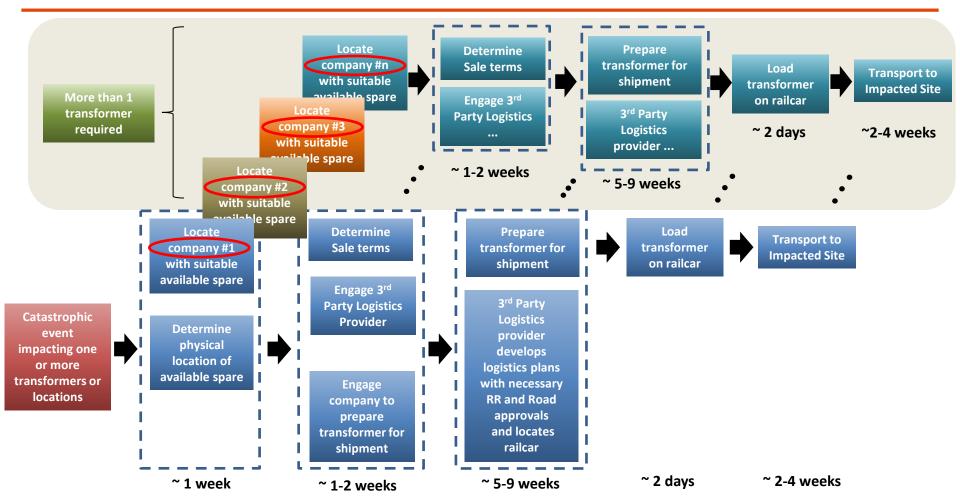

### Projected delivery time to site: 9 – 16+ weeks for a <u>single</u> EHV Transformer

If multiple transformers damaged, impacted company will likely have to acquire spares from multiple companies which could significantly lengthen total delivery time